



Caution Solar Circuit

Stickers for EMT/Conduit every 60" & 24" from each turn

Caution Solar Circuit


SOLAR PHOTOVOLTAIC DISCONNECT FOR UTILITY OPERATION

OPERATING CURRENT _____ AMP
 SHORT CIRCUIT CURRENT _____ AMP
 OPERATING VOLTAGE _____ VDC
 MAXIMUM SYSTEM VOLTAGE _____ VDC

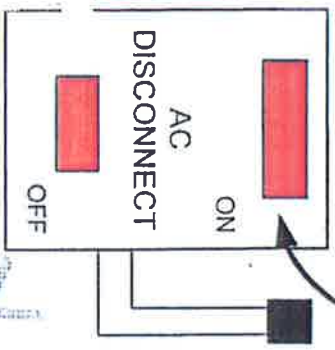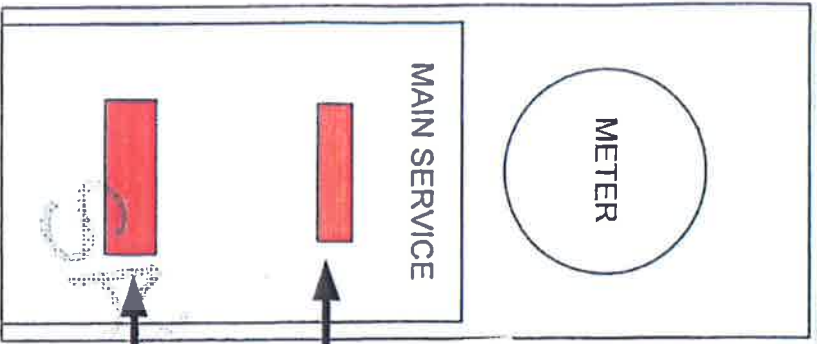

WARNING
 THIS SERVICE METER IS ALSO SERVED BY A PHOTOVOLTAIC SYSTEM

WARNING
 ELECTRICAL SHOCK HAZARD. DO NOT TOUCH TERMINALS. TERMINALS ON BOTH THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

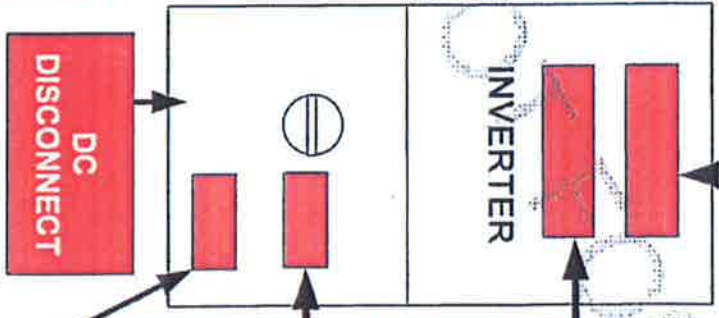

WARNING
 ELECTRICAL SHOCK HAZARD. DO NOT TOUCH TERMINALS. TERMINALS ON BOTH THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

WARNING
 ELECTRIC SHOCK HAZARD IF GROUNDED FAULT IS INDICATED NORMALLY GROUNDED CONDUCTORS MAY BE UNGROUNDED AND ENERGIZED

WARNING
 INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE